Specifications							
IO-Link Signal Beacons NE-IL							
Model	NE-ILNB-M	NE-ILTB-M	NE-ILXB-M With buzzer, touch sensor,	NE-ILNN-M	NE-ILTN-M		
	With buzzer	With buzzer and touch sensor	and digital / analog input	Without Buzzer	With touch sensor		
Size	φ56mm						
Rated Voltage	24V DC						
Mounting Location / Mounting Direction	Indoors, Upright						
Protection Rating	IP65 NEMA TYPE 4X, 13						
LED Color	Multi-color (Red, Amber, Green, Blue, White, Purple, Cyan)						
LED Unit Modes	Continuous / Flashing						
Sound Pressure	Typ. 88 dB [8 sound types (Selectable)] -						
Conformity Standards	●EMC Directive (EN 61000-6-4, EN 61000-6-2) ●RoHS Directive (EN 50581) ●UL 508, CSA-C22.2 No. 14 ● FCC Part 15 Subpart B Class A ● KC (KN 61000-6-4, KN 61000-6-2)						
Connection	M12 connector 5 pins A code M12 connector 8 pins A code M12 connector 5 pins A code						

IO-Link Signal Tower LR6-IL						
Model	LR6-3ILWMNW-RYG Pre-assembled Model (Direct mount)	Body Unit (Direct mount)	LR6-ILWCNW Body Unit (1/2" NPT pipe or direct mount)			
Size	φ60mm					
Rated Voltage	24V DC					
Mounting Location / Mounting Direction	Indoors, Upright					
Tier	LED Unit: Max. 5 tiers and one buzzer unit					
LED Color	Red / Amber / Green (Blue and White LED units also available)	N/A - LED units are sold separately				
LED Unit Modes	Continuous / Flashing					
Buzzer Sound Pressure	Typ. 84 dB (Use LR6-BW)					
Buzzer Sound Selection	4 sound types (Selectable) (Use LR6-BW)					
Protection Rating	IP65 NEMA TYPE 4X, 13					
Conformity Standards	●EMC Directive (EN 61000-6-4, EN 61000-6-2) ●RoHS Directive (EN 50581) ●UL 508, CSA-C22.2 No. 14 ● FCC Part 15 Subpart B Class A ● KC (KN 61000-6-4, KN 61000-6-2)					
Connection	M12 connector 5 pins A code					

#### How to Order

#### **NE-ILXB-M**

Touch Sensor X : With touch sensor and digital / analog input\* Buzzer T : With touch sensor N : No touch sensor \* Only with buzzer type N : Without Buzzer

LED Color M : Multi-color B : With Buzzer

www.patlite-ap.com

## PATLITE (SINGAPORE) PTE LTD

• PATLITE, the PATLITE logo are either registered trademarks or trademarks of PATLITE Corporation in JAPAN and/or other countries.

The names of other companies and products are trademarks or registered trademarks of their respective companies

No.2 Leng Kee Road, #05-01 Thye Hong Centre, Singapore 159086 TEL.+65-6226-1111 FAX.+65-6324-1411 E-mail: sales@patlite.com.sg

**PATLITE** Corporation achi, Chuo-ku, Osaka 541-0056 Japan

International Sales Division TEL.+81-6-7711-8953 FAX.+81-6-7711-8961 E-mail: overseas@patlite.co.jp


PATLITE (U.S.A.) Corporation 20130 S. Western Ave. Torrance, CA 90501, U.S.A. TEL.+1-310-328-3222 FAX.+1-310-328-2676 E-mail: sales@patiite.com


PATLITE (CHINA) Corporation

Room 1102-1103, No.55, Lane 777, Guangzhong Road (West), ZhabeiDistrict, Shanghai, China 200072 TEL.+86-21-6630-8969 FAX.+86-21-6630-8938 E-mail: sales@patiite.cn PATLITE Europe GmbH

Am Soeldnermoos 8, D-85399 Hallbergmoos, Germany TEL-49-811-9981-9770-0 FAX-49-811-9981-9770-90 E-mail: info@patilte.eu WEEE Reg. Nr. 67267160

LR6-3ILWMNW-RYG LED Unit Color





M12 connector (3-point mounting) WC: Direct mounting / M12 connector (M30 nut attached)

PATLITE KOREA CO., LTD. A-2603, Daesung D-POLIS, 606, Seobusaet-gil, Geumcheon-gu, Seoul, 08504, Korea TEL.+82-2-523-6636 FAX.+82-2-861-9919 E-mail: sales@patilite.co.kr PATLITE TAIWAN CO., LTD. 2F-1, No.215, Sec. 2, Chengde Rd., Datong Dist., Taipei City 103645, Taiwan (R.O.C.) TEL. +886-2-2552-9611 FAX. +886-2-2552-9811 E-mail: info@patite.tw

PATLITE (THAILAND) CO., LTD. Olympia Thai Tower, 15th Floor 444 Ratchadapisek Road Samsennok, Huay Kwang Bangkok 10310, Thailand TEL.+66-2-541-5431 FAX.+66-2-541-5429 E-mail: sales\_150716@patilite.co.th PATLITE MEXICO S.A. de C.V.

Plaza de La Paz No. 102, int. 712 Guanajuato Puerto Interior, Silao, Gto, C.P.36275, Mexico TEL.+52-472-748-9124 E-mail: ventas@patiite.com.mx

#### **A**CAUTION

RYG: Red, Amber, Green

To ensure correct use of these products, read the "Instruction Manual" prior to use. Failure to follow all safeguards can result in fire, electric shock, or other accidents.Specifications are subject to change without notice.

#### 0-Al06D SG 2011




# **IO-Link Product Catalog**



# www.patlite-ap.com

# **O**-Link × **PATLITE**

IO-Link is an open-standard protocol that enables bi-directional data communication between devices and the master. Incorporate PATLITE signal devices into IO-Link to facilitate and enhance manufacturing processes.

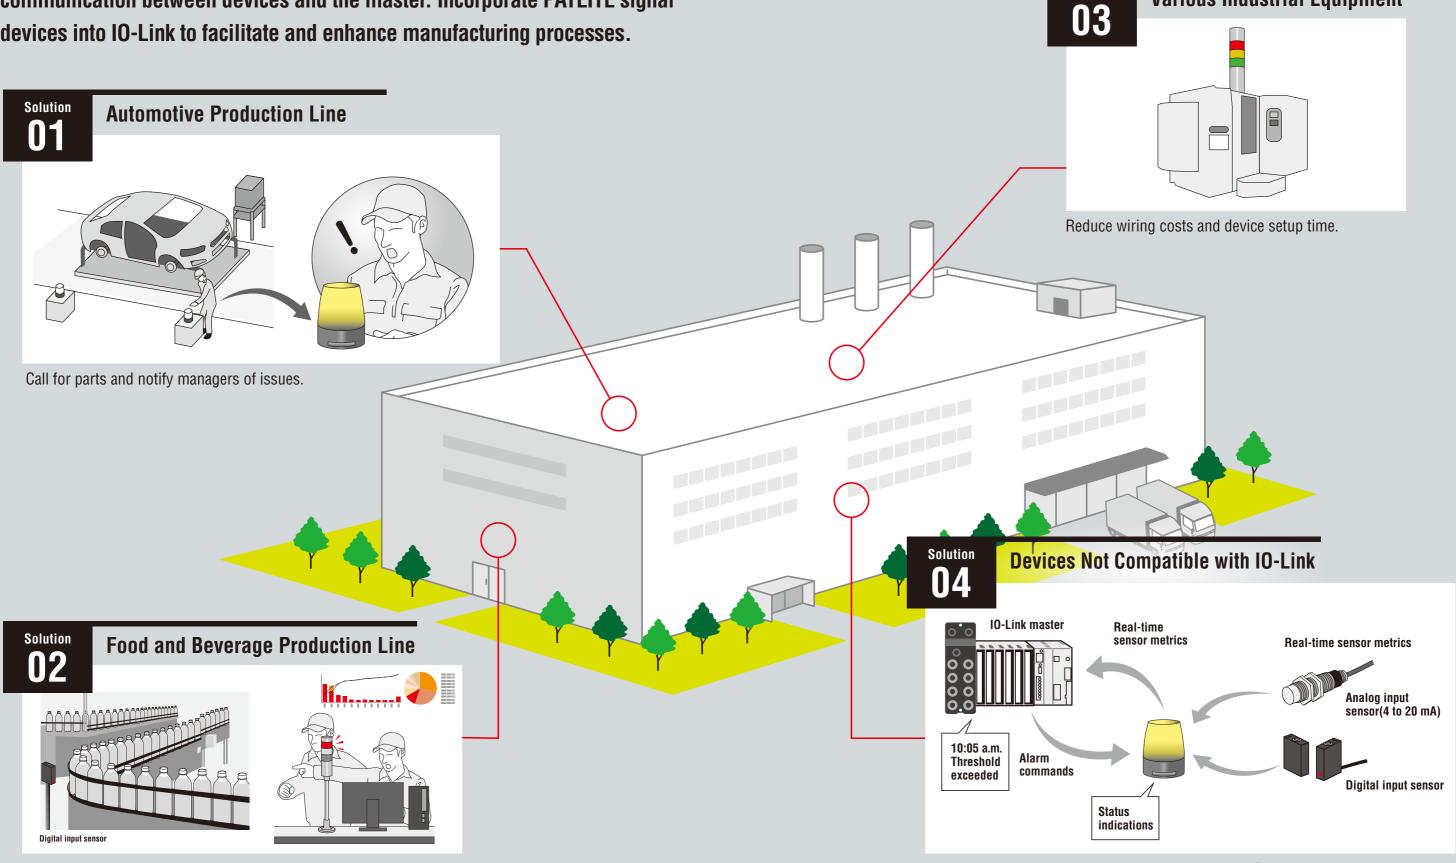

Acquire real-time equipment status and collect operational metrics.


Enables integration of non-compatible devices into IO-Link.


## **Various Industrial Equipment**


Solution

Solution 01

### Call for parts or request assistance with a single touch





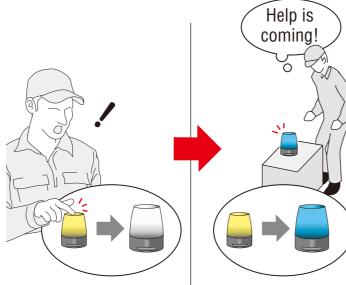


The manager instantly notices the alarms, and determines where and what the issue is according to the illuminated color. The manager can touch the NE-IL to send notification back to the production site to indicate that help is on the way.


# Solution 02

## **Food and Beverage Production Line**

Anticipate issues and enhance predictive maintenance



The IO-Link master acquires real-time operational data of the sensors and other devices that are connected. This data can be monitored remotely, and collected for further analysis.

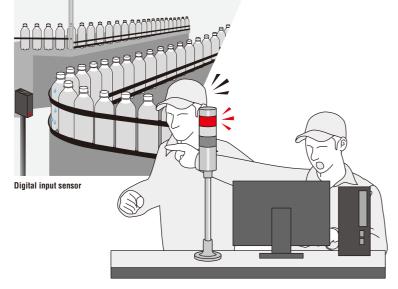


When device abnormalities such as water or dust obstruction is detected, the IO-Link master sends commands to the LR6-IL Signal Tower to activate its visual and audible alarms to indicate the specific problem. Identify device issues before it happens to avoid equipment malfunctions and halts in production.



# **Various Industrial Equipment**


#### Standardizing with IO-Link reduces overall costs


The NE-IL Signal Beacons and LR6-IL Signal Towers can be connected to IO-Link with a single M12 cable. This minimizes wiring requirements, which reduces labor and costs. In addition, IO-Link allows for easy replacement of old or damaged devices, as it automatically imports previous settings to the new device.

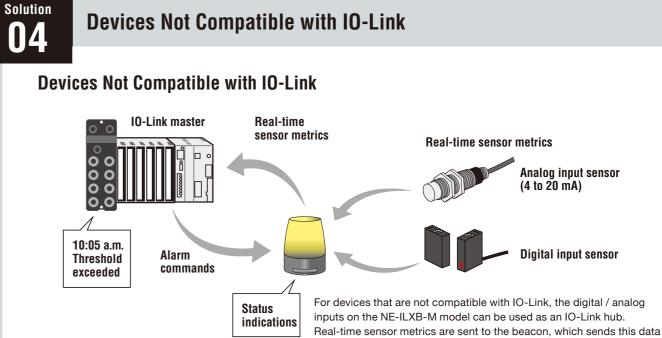

# Example of Use

## Achieve timely responses to issues

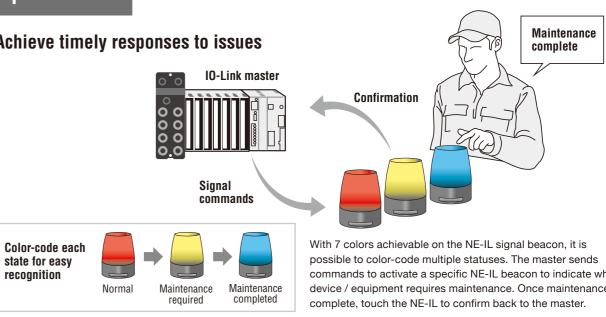



to the master. The master can then send specific commands to activate the beacon alarms.

> commands to activate a specific NE-IL beacon to indicate which device / equipment requires maintenance. Once maintenance is

# **♦ IO**-Link Signal Beacons NE-IL

# **♦ IO**-Link Signal Tower LR6-IL



